


# LARGE GREASE INTERCEPTOR



5200

FABRICATED STEEL GREASE INTERCEPTOR WITH THREADED INLET/OUTLET, DOUBLE WALL TRAP, REMOVABLE FILTER SCREEN, SECURED NON-SKID GASKETED COVER, INTERNAL Baffle, INTERNAL FLOW CONTROL AND BRASS CLEANOUT PLUG.

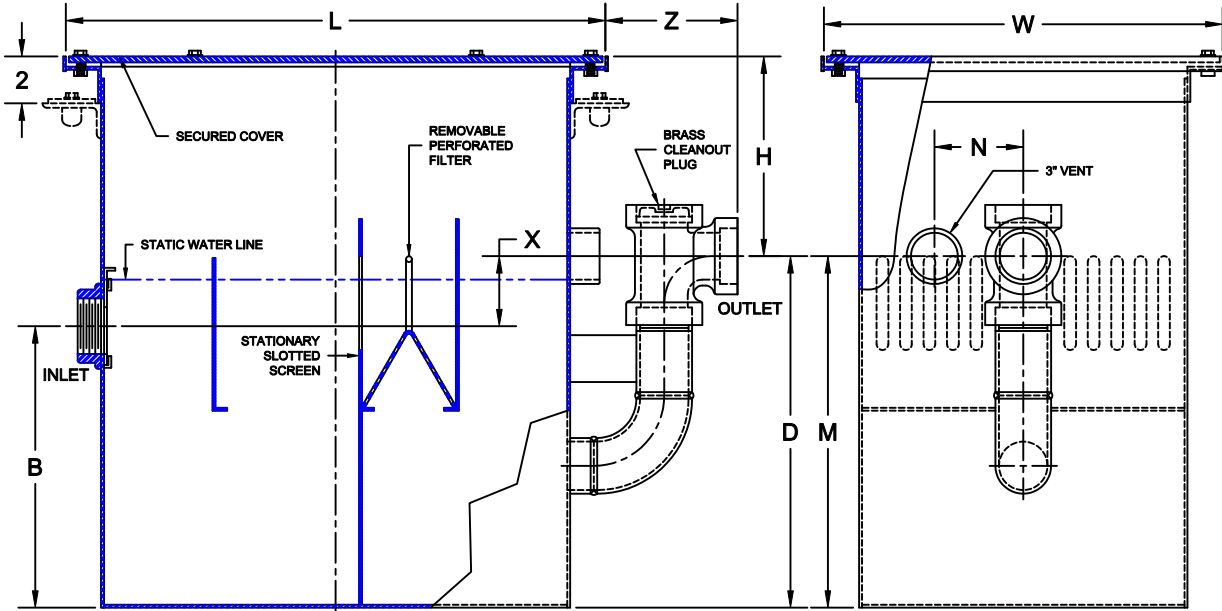

MODEL	PIPE SIZE	FLOW RATE (GPM)	GREASY SLUDGE (LB)	HOLDING CAPACITY (GAL)	HOLDING CAPACITY (CU.FT.)	H (MIN)	B	D	L	W	X	M	N	Z	QTY OF COVERS	WT (LB)
5200-050	4	50	150	65	8.8	8	17 3/4	22	35	25	4 1/4	26	5 1/8	13 3/8	1	450
5200-075	4	75	180	85	9.9	8	17 3/4	22	35	30	4 1/4	26	7 5/8	13 3/8	1	549
5200-100	4	100	250	95	11.0	8	17 3/4	22	40	30	4 1/4	26	7 5/8	13 3/8	1	638
5200-150	4	150	375	150	19.7	13	22 1/2	27	45	36	4 1/2	34	10 5/8	13 3/8	2	821
5200-200	6 *	200	500	225	34.0	14 3/4	29	35 1/4	52	36	6 1/4	44	10 5/8	18 3/8	2	1,175
5200-250	6 *	250	625	400	54.8	21	39 1/2	46	61	42	6 1/2	59	10 5/8	18 3/8	2	1,951
5200-300	6 *	300	725	500	74.8	26 3/4	33 1/2	36 3/4	71	54	3 1/4	55	15 5/8	18 3/8	2	2,250
5200-350	6 *	350	850	600	87.6	20	37	43 1/2	71	54	6 1/2	55	15 5/8	18 3/8	2	2,611
5200-400	6 *	400	1000	730	106.2	17	40	46 1/2	80	54	6 1/2	55	19 5/8	18 3/8	3	2,705
5200-500	6 *	500	1250	800	120.6	19 1/2	40	46 1/2	86	57	6 1/2	58	15 1/8	18 3/8	3	2,994
5200-750	6 *	750	1500	1100	121.0	22 1/2	43	49 1/2	115	57	6 1/2	64	15 1/8	18 3/8	4	3,218
5200-937	6 *	937	1500	1500	224.0	29	48	55	146 3/4	50 3/4	6 1/2	74	15 1/8	18 3/8	5	4,212
5200-1250	6 *	1250	2600	2000	272.8	23	42	49	182 3/4	60	7	62	16 5/8	18 3/8	6	5,325

\* 6" PIPE SIZE HAS 125# FLANGED CONNECTION STANDARD

H = DIMENSION FROM INLET TO TOP (SPECIFY) \_\_\_\_\_

**OPTIONS**

Suffix	Description
<input type="checkbox"/> 24	ANCHOR FLANGE
<input type="checkbox"/> 26	ANCHOR FLANGE W/ CLAMP DEVICE
<input type="checkbox"/> 27	SEDIMENT BASKET
<input type="checkbox"/> HD	HEAVY DUTY COVER
<input type="checkbox"/> CP	COALESCING PACK
<input type="checkbox"/> DW	DOUBLE WALL
<input type="checkbox"/> FM	FILTER MEDIUM
<input type="checkbox"/> AC	ALUMINUM COVER

**OPTIONS**

Suffix	Description
<input type="checkbox"/> SA	SACRIFICIAL ANODES
<input type="checkbox"/> ARE	EPOXY COATING
<input type="checkbox"/> SS	ALL STAINLESS STEEL CONSTRUCTION
<input type="checkbox"/> XT	INTEGRAL EXTENSION (SPECIFY HEIGHT)
<input type="checkbox"/> NH	NO-HUB CONNECTIONS
<input type="checkbox"/> TY	HUB CONNECTIONS


AutoCad.dwg

# LARGE GREASE INTERCEPTOR



5200

FABRICATED STEEL GREASE INTERCEPTOR WITH THREADED INLET/OUTLET, DOUBLE WALL TRAP, REMOVABLE FILTER SCREEN, SECURED NON-SKID GASKETED COVER, INTERNAL Baffle,

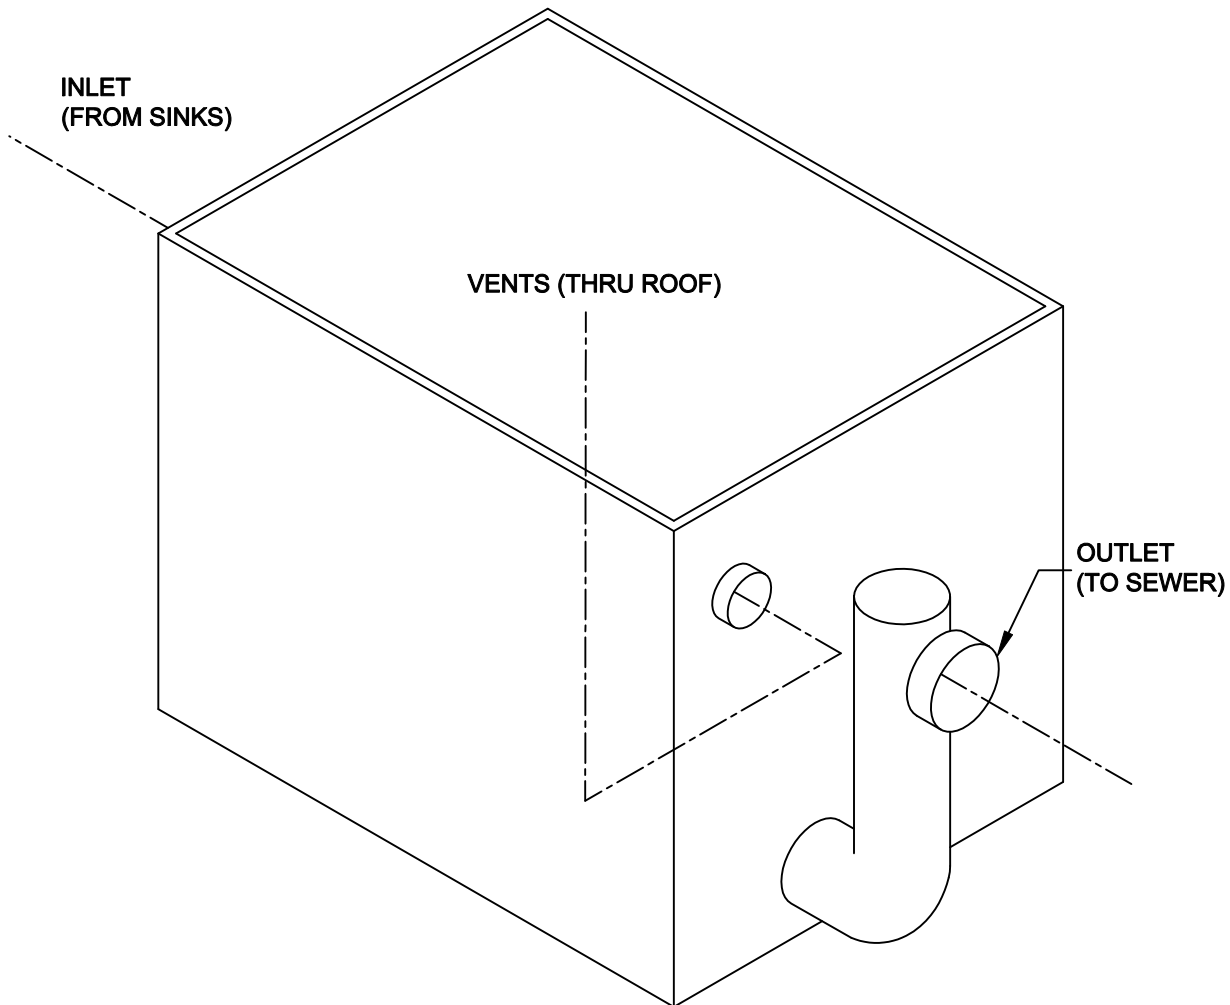

## INSTALLATIONS:

## GREASE INTERCEPTOR

1. CHECK LOCAL CODE REQUIREMENTS BEFORE BEGINNING INSTALLATION.
2. VERIFY THAT NO OBSTRUCTIONS WILL BE PLACED OVER THE INTERCEPTOR AFTER INSTALLATION. A MINIMUM CLEARANCE EQUAL TO THE OVERALL HEIGHT OF THE INTERCEPTOR IS RECOMMENDED.
3. POSITION INTERCEPTOR SO THAT IT IS LEVEL AND CONNECT PIPING TO THE INLET AND OUTLET.
4. CONNECT PIPING TO THE INTERCEPTOR VENTS. VENTS TO ATMOSPHERE WITH EACH TERMINATING 12 INCHES ABOVE THE OTHER IS DESIRED.