

Approval Date

Customer Approval


Job Location

Job Name

Dimensional Data (Inches/mm) are Subject to Manufacturers Tolerance and Change Without Notice. Wade Division / Tyler Pipe Assumes No Responsibility For Superseded or Voided Data

5P-100P

WADE WATER HAMMER ARRESTERS EMPLOY A PERMANENTLY SEALED AIR CHAMBER TO ABSORB ENERGY FROM COMMON WATER HAMMER. UNITS SHOULD BE SIZED IN ACCORDANCE WITH PDI STANDARD WH-201. CERTIFIED BY AMERICAN SOCIETY OF SANITARY ENGINEERING ANSI/ASSE 1010. APPROVED FOR INSTALLATION WITH NO ACCESS PANEL REQUIRED

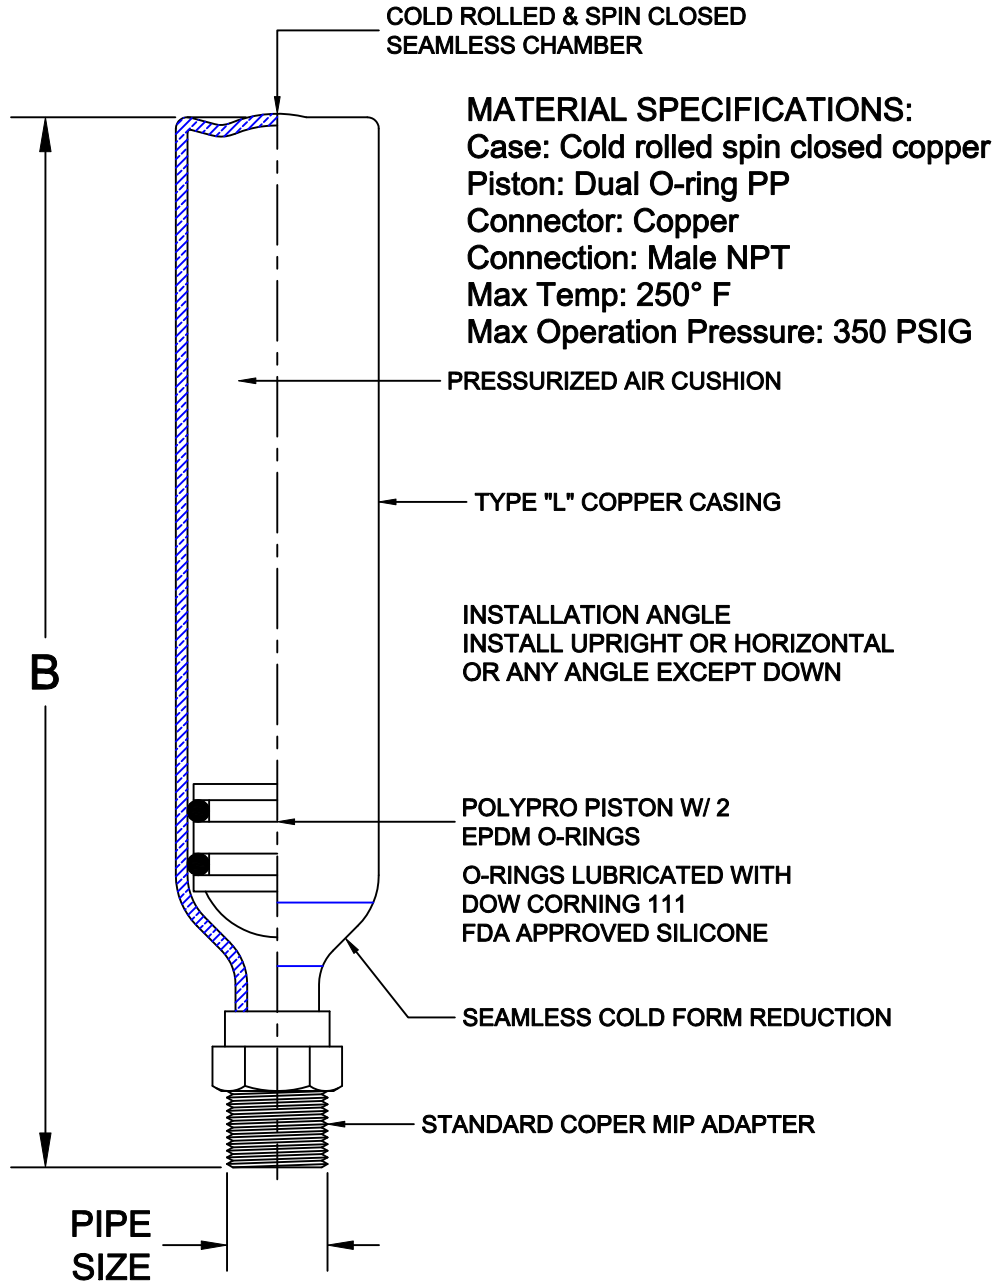

CATALOG NUMBER	P.D.I. SYMBOL	FIXTURE UNIT RATING	PIPE SIZE	B	B
5P	A	1-11	1/2" (13)	1 3/8 (35)	6 1/2 (35)
10P	B	12-32	3/4" (19)	1 3/8 (35)	8 3/4(222)
20P	C	33-60	1" (25)	1 3/8 (35)	11 (279)
50P	D	61-113	1" (25)	2 1/8 (54)	10 1/8 (257)
75P	E	114-154	1" (25)	2 1/8 (54)	12 5/8 (320)
100P	F	155-330	1" (25)	2 1/8 (54)	15 1/8 (384)